


NOTES:

- 1) REFER TO SECTION 15112 OF THE SPECIFICATIONS
- 2) INSTALL WARNING/IDENTIFICATION TAPE AS SHOWN ON WP-01
- 3) LOCATE BACKFLOW PREVENTION DEVICE (BPD) IN SUCH A MANNER THAT WILL ALLOW THE DEVICE TO BE READILY ACCESSIBLE FOR INSPECTION & REPAIR
- 4) ALL ABOVE GROUND PIPING, UNIONS, ELBOWS, & NIPPLES SHALL BE SOLDERED OR THREADED BRASS
- 5) NO CONNECTIONS OF ANY KIND WILL BE ALLOWED IN THIS AREA. INSPECTION BY THE DISTRICT SHALL TAKE PLACE PRIOR TO BACKFILL. INSTALL A CASING ENCASED IN CONCRETE WHEN THE DISTANCE BETWEEN THE METER BOX AND THE RISER TO THE BPD EXCEEDS 450mm (18"). NO CONNECTIONS OF ANY KIND WILL BE PERMITTED IN THIS AREA, INSPECTED REQUIRED PRIOR TO BACKFILL
- 6) INSTALL AN ANGLE PRESSURE REDUCING VALVE IN LIEU OF THE FIRST 90° ELL WHEN SYSTEM PRESSURE EXCEEDS 1.03 MPa (150 PSI) OR WHEN RECOMMENDED BY THE BACKFLOW MANUFACTURER
- 7) TESTING SHALL BE CONDUCTED IN ACCORDANCE WITH SECTION 15112 OF THE SPECIFICATIONS PRIOR TO ACCEPTANCE BY THE DISTRICT
- 8) BPD & APPURTENANCES INSTALLED FOR THE USE OF RECYCLED WATER SHALL BE IDENTIFIED AS DESCRIBED IN SECTION 15151 OF THE SPECIFICATIONS
- 9) MATERIALS SHALL BE SELECTED FROM THE APPROVED MATERIALS LIST




ITEM NO.	SIZE AND DESCRIPTION	ITEM NO.	SIZE AND DESCRIPTION
1	METER BOX & METER ASSEMBLY SEE WS-01 & WS-02	6	BRASS OR COPPER PIPE SEE NOTE 4
		7	75mm (3") LONG NIPPLE SEE NOTE 4
2	SCH 80 PVC, BRASS OR COPPER PIPE	8	BALL VALVE "SHUT-OFF"
3	CONCRETE THRUST BLOCK SEE WT-01	9	REDUCED PRESSURE BACKFLOW DEVICE
4	90° ELL SEE NOTES 4 & 6	10	ENCLOSURE (OPTIONAL)
5	CONCRETE SLAB, MINIMUM 100mm (4") THICK x 450mm (18") WIDE	11	UNION SEE NOTE 4
		12	ANGLE PRV SEE NOTES 4 & 6

19mm THRU 50mm (3/4" THRU 2") REDUCED PRESSURE BACKFLOW PREVENTION DEVICE

WATER AGENCIES STANDARDS
 COMMITTEE APPROVAL: 02/01/2008
 DRAWING NUMBER: WR-01


H:\WAS&WASDG\2008\WAS&WASDG02-01-08\WAS\StandardDrawings\Water\wr01_02-01-08.dgn
 PEN TEL k:\table\WASDETAIL.PEN

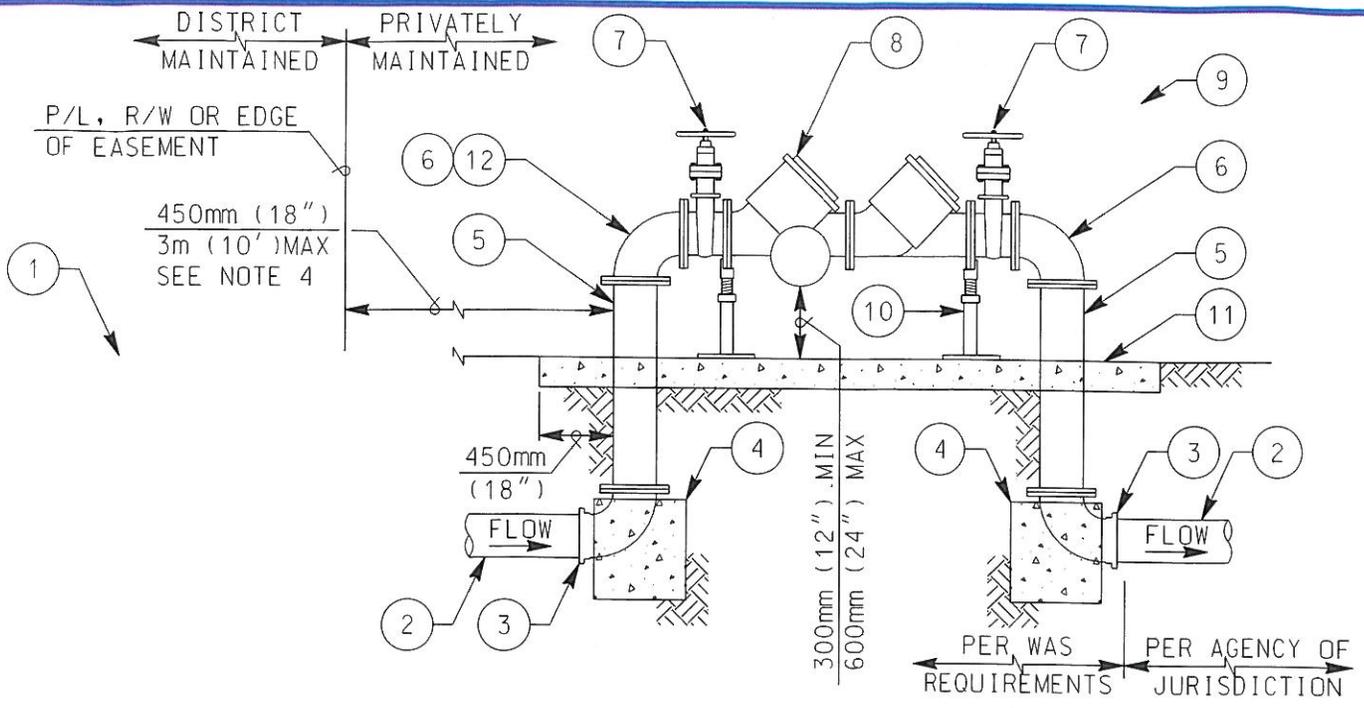

NOTES:

- 1) REFER TO SECTION 15112 OF THE SPECIFICATIONS
- 2) INSTALL WARNING/IDENTIFICATION TAPE AS SHOWN ON WP-01
- 3) LOCATE BACKFLOW PREVENTION DEVICE (BPD) IN SUCH A MANNER THAT WILL ALLOW THE DEVICE TO BE READILY ACCESSIBLE FOR INSPECTION & REPAIR
- 4) INSTALL A CASING ENCASED IN CONCRETE WHEN THE DISTANCE BETWEEN THE METER BOX AND THE RISER TO THE BPD EXCEEDS 450mm (18"). NO CONNECTIONS OF ANY KIND WILL BE PERMITTED IN THIS AREA, INSPECTION REQUIRED PRIOR TO BACKFILL
- 5) INSTALL AN ANGLE PRESSURE REDUCING VALVE IN LIEU OF THE FIRST 90° ELL WHEN SYSTEM PRESSURE EXCEEDS 1.03 MPa (150 PSI) OR WHEN RECOMMENDED BY THE BACKFLOW MANUFACTURER
- 6) TESTING SHALL BE CONDUCTED IN ACCORDANCE WITH SECTION 15112 OF THE SPECIFICATIONS PRIOR TO ACCEPTANCE BY THE DISTRICT
- 7) BPD & APPURTENANCES INSTALLED FOR THE USE OF RECYCLED WATER SHALL BE IDENTIFIED AS DESCRIBED IN SECTION 15151 OF THE SPECIFICATIONS
- 8) MATERIALS SHALL BE SELECTED FROM THE APPROVED MATERIALS LIST

DETAIL 'A'
SEE NOTE 5



ITEM NO	SIZE AND DESCRIPTION	ITEM NO	SIZE AND DESCRIPTION
1	METER VAULT & METER ASSEMBLY, SEE WS-04	8	REDUCED PRESSURE BACKFLOW DEVICE
2	PVC OR DUCTILE IRON PIPE	9	ENCLOSURE (OPTIONAL)
3	FLG x FLG OR MJ/PO x FLG 90° BEND	10	ADJUSTABLE VALVE SUPPORT
4	CONCRETE THRUST BLOCK SEE WT-01	11	CONCRETE SLAB, MINIMUM 100mm (4") THICK x 900mm (36") WIDE
5	FLANGED DUCTILE IRON PIPE	12	FLANGED ANGLE PRESSURE REDUCING VALVE SEE NOTE 5
6	FLANGED 90° BEND, SEE NOTE 5		
7	FLANGED RESILIENT WEDGE GATE VALVE		

75mm (3") AND LARGER REDUCED PRESSURE BACKFLOW PREVENTION DEVICE

WATER AGENCIES STANDARDS
 COMMITTEE APPROVAL: 11/23/2011
 DRAWING NUMBER: WR-02

H:\WAS\ASDG\2011\WASDG11-23-2011\WASStandardDrawings\Water\wr02_11-23-11.dgn
 PEN TBL: ...WAS\PenTbl\WAS_8-12-10.tbl
 kgall...